


New full footway construction in worn section of verge to extend the slope to a natural intersection with the footway. Footway to be 100mm type 1 material sub-base with 50mm base course and 20mm surface course. Any excavated material to be removed from site.

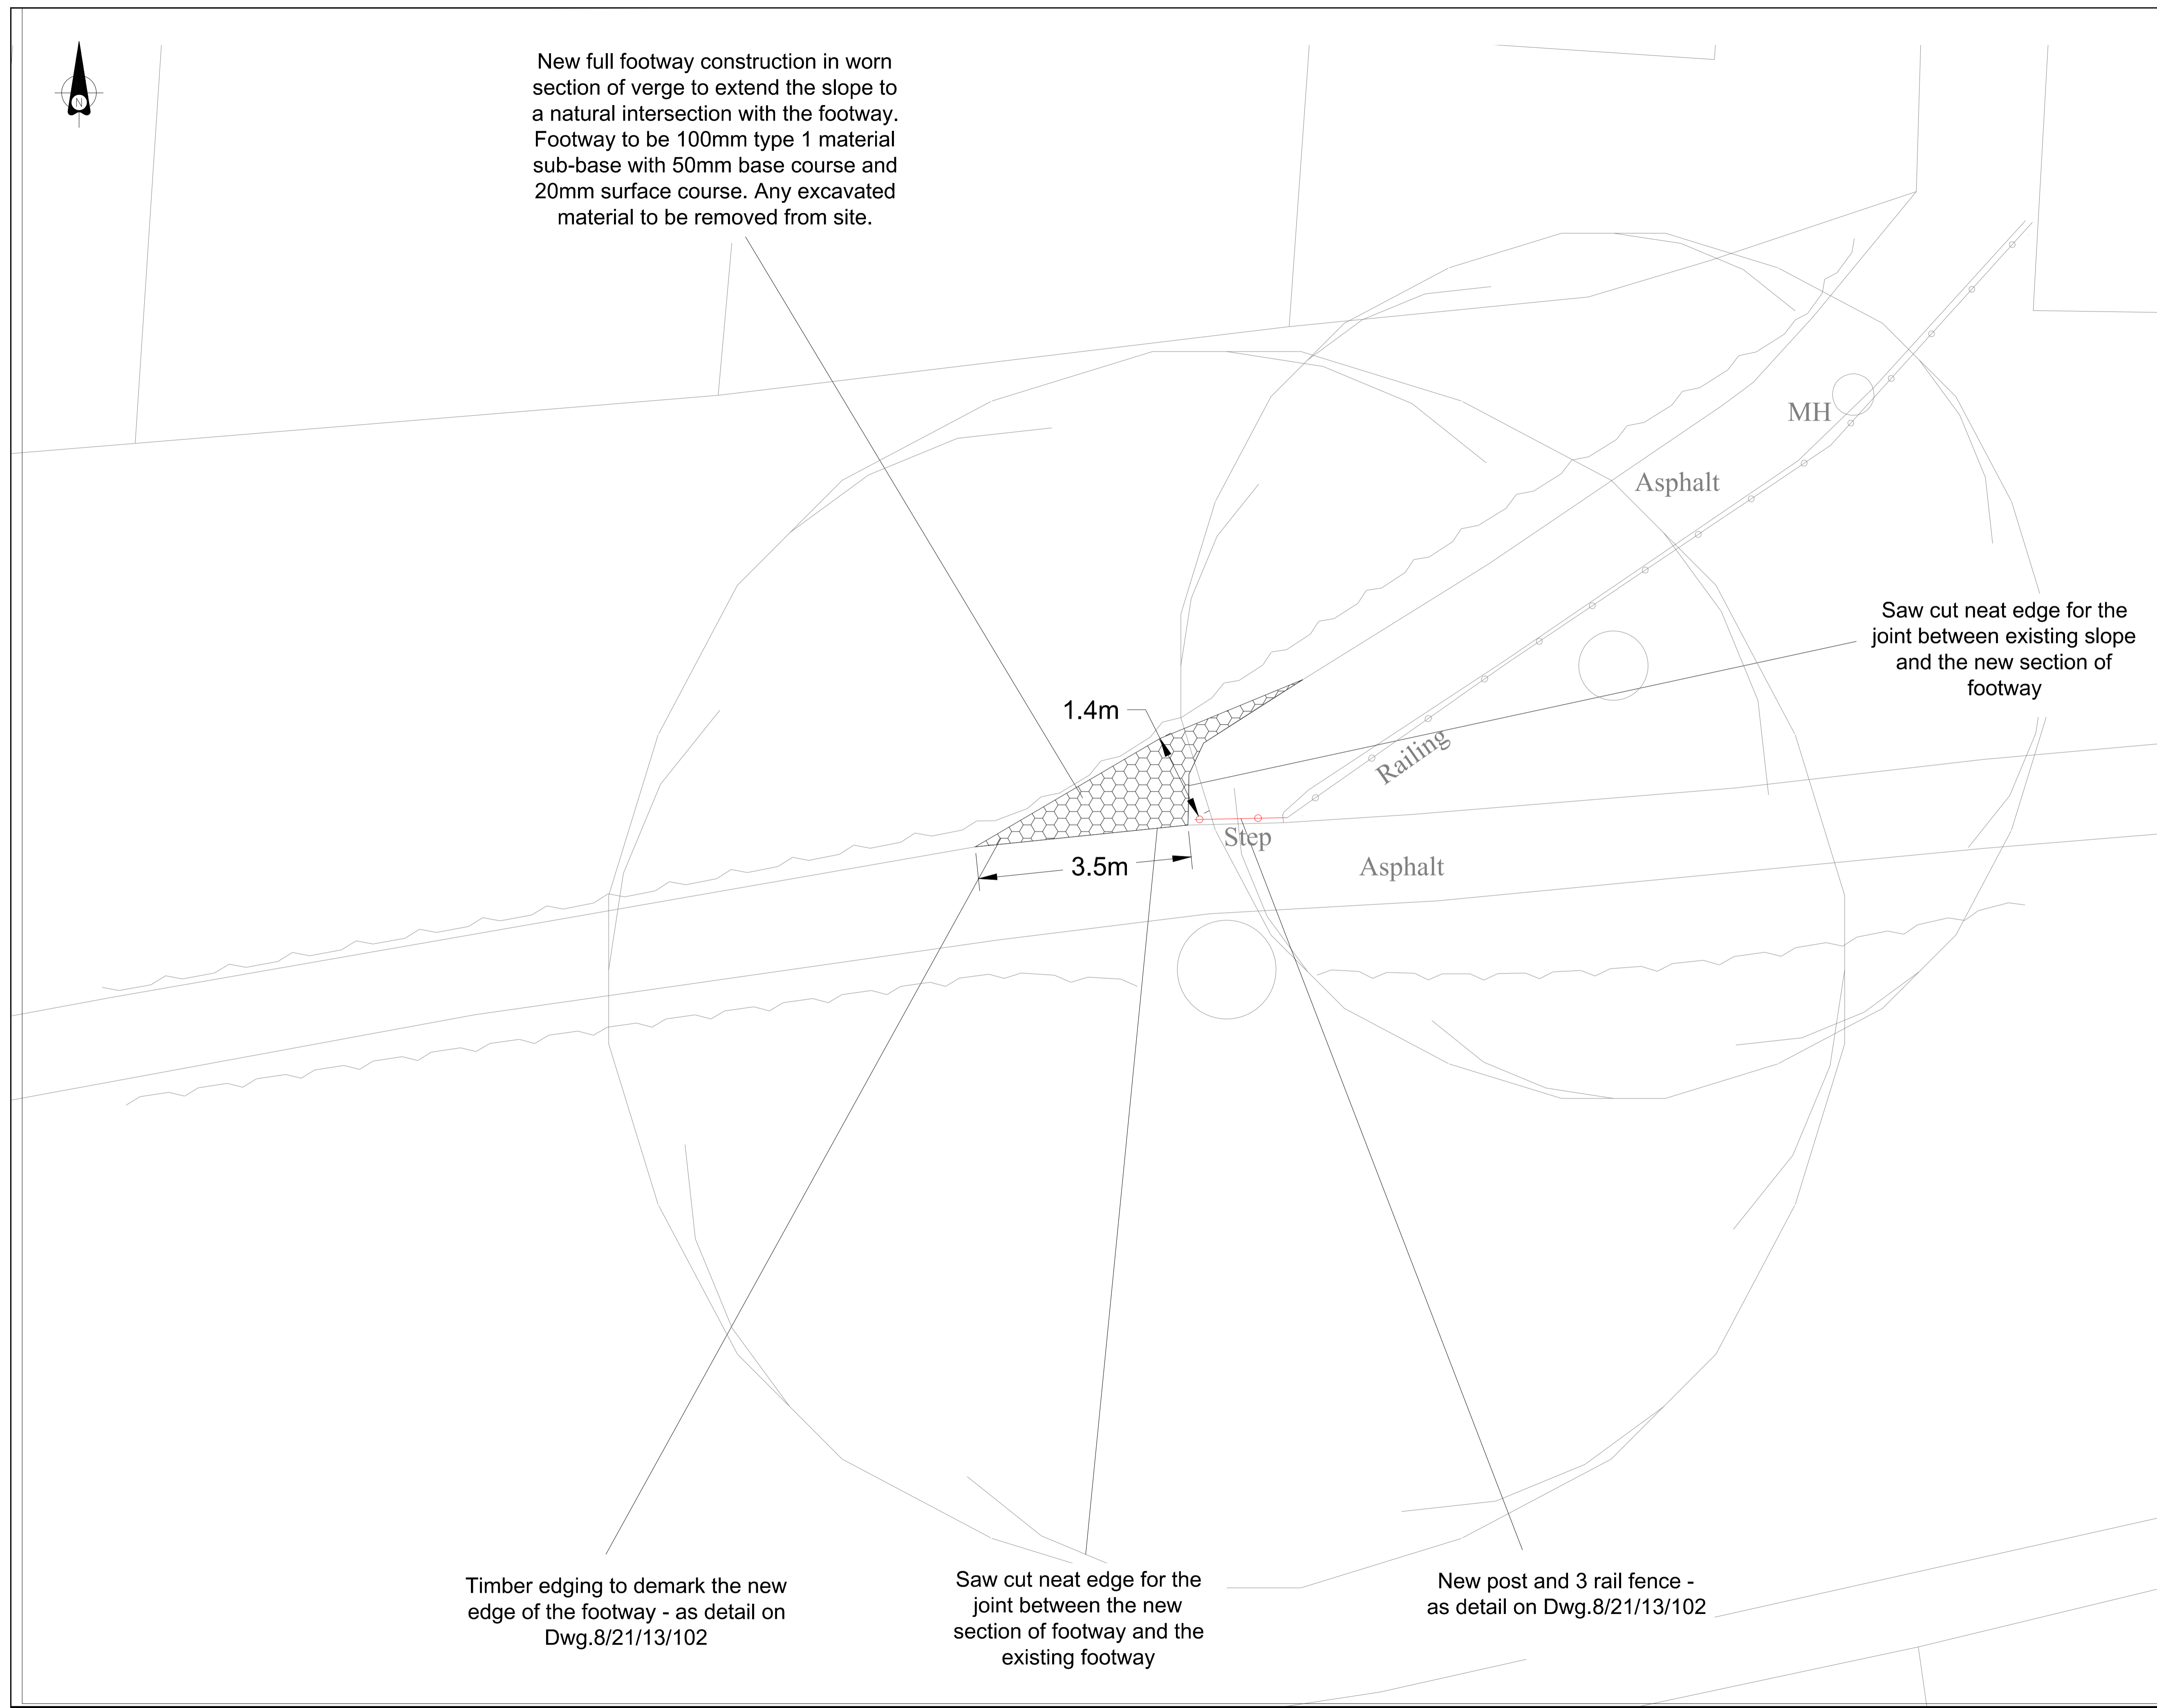

Timber edging to demark the new edge of the footway - as detail on Dwg.8/21/13/102

Saw cut neat edge for the joint between the new section of footway and the existing footway

New post and 3 rail fence - as detail on Dwg.8/21/13/102

Saw cut neat edge for the joint between existing slope and the new section of footway

REVISIONS

no.	date	By	Checked	details


drawing number 8/21/13\_103

NOTES

- | no.                 | details  |
|---------------------|--|
| <b>General</b>      |  |
| 1.                  | All Dimensions in Metres unless otherwise stated.  |
| 2.                  | All Clause numbers refer to the clauses in the Specification for Highways Works.   |
| 3.                  | The area should be checked for services prior to any excavation taking place.  |
| 4.                  | Any vegetation removal shall be done outside of the bird nesting season.   |
| <b>Materials</b>    |  |
| 5.                  | Sub base shall be granular stone to Clause 803, compacted to Clause 802. Normal depth to be 100mm, unless greater depth is required for filling to finished level.   |
| 6.                  | Bituminous surfacing materials shall be as follows. Surface Course 20mm thick AC6 Dense Surf100/150, to BS EN 13108-5 and BS 594987 with Minimum PSV 55. Binder Course 50mm thick AC20 Dense Bin 100/150 to BS EN 13108-1 and BS 594987. |
| 7.                  | Concrete shall be mix C30 unless otherwise specified. Any exposed concrete shall be given a wood float finish.   |
| 8.                  | Limestone Aggregate shall not be used in any concrete or Bituminous materials that are to be used as finished surfaces for any of the works.   |
| <b>Construction</b> |  |
| 9.                  | The finished surface of any footway shall not deviate from the specified line or levels by more than 5mm.  |
| 10.                 | Surface course material shall be laid flush with any edgings along the footway.  |
| 11.                 | Areas of grass to be excavated to a depth of 50mm to form a sound formation for any new construction.  |
| 12.                 | Any soft spots within the formation shall be excavated and filled with sub base to formation level, as directed by the supervising Engineer.   |
| 13.                 | A minimum of 150mm of topsoil shall be placed in areas to be grass seeded.   |
| 14.                 | Grass areas to be cleared of stones and debris and raked to a fine tilth prior to seeding with suitable grass seed.  |

Reproduced from the Ordnance Survey mapping with the permission of the Controller of Her Majesty's Stationary Office @ Crown copyright and database rights 2020 OS 100022695. Unauthorised reproduction infringes Crown copyright and may lead to prosecution or civil proceedings

drawn	RJW	scale(s)	scale 1:50 @ A1
checked	RDS	date	02/10/2020

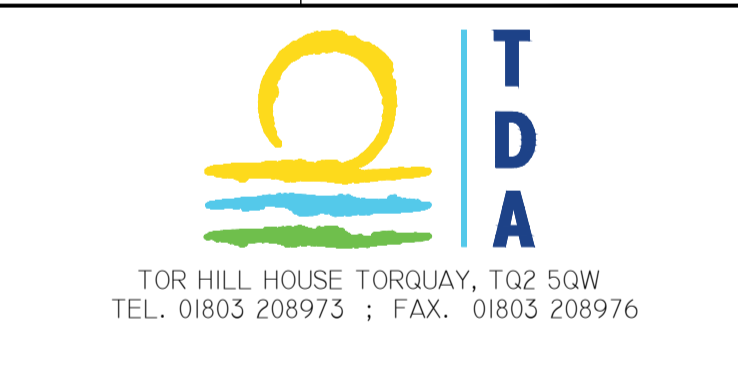

SCHEME TITLE  
**BRIDGETOWN FOOTWAY IMPROVEMENTS**

DRAWING TITLE  
**Bridgewater Gardens**

Purpose  
**FOR CONSTRUCTION**

drawing number	8/21/13_103	rev.	-
----------------	-------------	------	---